

## Perform A/S

Ndr. Stationsvej 4  
DK-8721 Daugaard  
Denmark

Tel: 00 45 7022 6230 Fax: 00 45 7022 6240  
e-mail: perform@perform.dk  
website: www.perform.dk



Agrément Certificate  
**09/4681**  
Product Sheet 1

## PERFORM FLASHINGS


## PERFORM FLEXIBLE ROOF FLASHING

### PRODUCT SCOPE AND SUMMARY OF CERTIFICATE

This Certificate relates to Perform Flexible Roof Flashing, for use as waterproofing in flashing applications on flat and pitched roofs, as an alternative to lead flashing.

#### AGRÉMENT CERTIFICATION INCLUDES:

- factors relating to compliance with Building Regulations where applicable
- factors relating to additional non-regulatory information where applicable
- independently verified technical specification
- assessment criteria and technical investigations
- design considerations
- installation guidance
- regular surveillance of production
- formal three-yearly review.

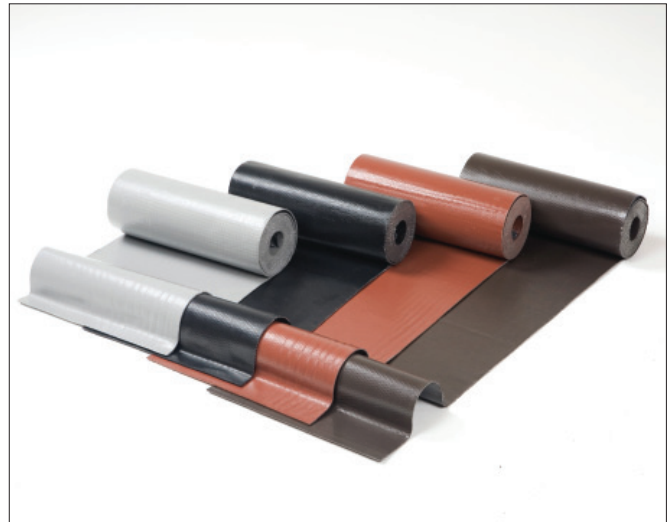

#### KEY FACTORS ASSESSED

**Weather-tightness** — as part of a complete roof, the product will contribute to resisting the passage of moisture into the interior of the building (see section 5).

**Properties in relation to fire** — tests indicate that the product when used as part of a complete roof will be unrestricted under the Building Regulations (see section 6).

**Strength** — the product has adequate strength to resist the loads associated with the installation of the roof (see section 7).

**Durability** — under normal service conditions, the product will have a service life in excess of 20 years (see section 9).

The BBA has awarded this Agrément Certificate to the company named above for the product described herein. This product has been assessed by the BBA as being fit for its intended use provided it is installed, used and maintained as set out in this Certificate.

On behalf of the British Board of Agrément

Simon Wroe  
Head of Approvals — Materials

Greg Cooper  
Chief Executive

Date of First issue: 7 September 2009

*The BBA is a UKAS accredited certification body — Number 113. The schedule of the current scope of accreditation for product certification is available in pdf format via the UKAS link on the BBA website at [www.bbacerts.co.uk](http://www.bbacerts.co.uk)*

*Readers are advised to check the validity and latest issue number of this Agrément Certificate by either referring to the BBA website or contacting the BBA direct.*

British Board of Agrément  
Bucknalls Lane  
Garston, Watford  
Herts WD25 9BA

©2009

tel: 01923 665300  
fax: 01923 665301  
e-mail: [mail@bba.star.co.uk](mailto:mail@bba.star.co.uk)  
website: [www.bbacerts.co.uk](http://www.bbacerts.co.uk)

# Regulations

In the opinion of the BBA, Perform Flexible Roof Flashing if used in accordance with the provisions of this Certificate, will meet or contribute to meeting the relevant requirements of the following Building Regulations:



## The Building Regulations 2000 (as amended) (England and Wales)

Requirement:	B4(2)	External fire spread
Comment:		Data to BS 476-3 : 2004 indicate that the product when used as part of a complete roof, will not effect the fire rating of the roof construction. See sections 6.1 and 6.2 of this Certificate.
Requirement:	C2(b)	Resistance to moisture
Comment:		The product will contribute to a roof meeting this Requirement. See section 5 of this Certificate.
Requirement:	Regulation 7	Materials and workmanship
Comment:		The product is acceptable. See section 9 and the <i>Installation</i> part of this Certificate.



## The Building (Scotland) Regulations 2004 (as amended)

Regulation:	8(1)(2)	Fitness and durability of materials and workmanship
Comment:		The product can contribute to a construction satisfying this Regulation. See sections 8 and 9 and the <i>Installation</i> part of this Certificate.
Regulation:	9	Building standards – construction
Standard:	2.8	Spread from neighbouring building
Comment:		Data to BS 476-3 : 2004 indicates that the product can be regarded as having a low vulnerability, with reference to clause 2.8.1 <sup>(1)(2)</sup> , and will not effect the fire rating of the roof construction. See sections 6.1 and 6.2 of this Certificate.
Standard:	3.10	Precipitation
Comment:		The product will contribute to a roof satisfying clauses 3.10.1 <sup>(1)(2)</sup> and 3.10.8 <sup>(1)(2)</sup> of this Standard. See section 5 of this Certificate.
Regulation:	12	Building standards – conversions
Comment:		All comments given for this product under Regulation 9, also apply to this Regulation, with reference to clause 0.12.1 <sup>(1)(2)</sup> and Schedule 6 <sup>(1)(2)</sup> . (1) Technical Handbook (Domestic). (2) Technical Handbook (Non-Domestic).



## The Building Regulations (Northern Ireland) 2000 (as amended)

Regulation:	B2	Fitness of materials and workmanship
Comment:		The product is acceptable. See section 9 and the <i>Installation</i> part of this Certificate.
Regulation:	B3(2)	Suitability of certain materials
Comment:		The product is acceptable. See section 8 of this Certificate.
Regulation:	C4(b)	Resistance to ground moisture and weather
Comment:		The product will contribute to a roof satisfying this Regulation. See section 5 of this Certificate.
Regulation:	E5(b)	External fire spread
Comment:		Data to BS 476-3 : 2004 indicate that the product when used as part of a complete roof construction will not effect the fire rating of the roof construction. See sections 6.1 and 6.2 of this Certificate.

## Construction (Design and Management) Regulations 2007

## Construction (Design and Management) Regulations (Northern Ireland) 2007

Information in this Certificate may assist the client, CDM co-ordinator, designer and contractors to address their obligation under these Regulations.

See section: 1 *Description* (1.2).

# Non-regulatory Information

## NHBC Standards 2008

NHBC accepts the use of Perform Flexible Roof Flashing, when installed and used in accordance with this Certificate, in relation to *NHBC Standards*, Chapters 6.8 *Fireplaces, chimneys and flues*, 7.1 *Flat roofs and balconies* and 7.2 *Pitched roofs*.

## Zurich Building Guarantee Technical Manual 2007

In the opinion of the BBA, Perform Flexible Roof Flashing, when installed and used in accordance with this Certificate, satisfies the requirements of the *Zurich Building Guarantee Technical Manual*, Section 4 *Superstructure*, Sub-sections *External walls – chimneys*, *External walls – parapets*, *Pitched roofs* and *Flat roofs*.

## General

The product is manufactured in Denmark by the Certificate holder and marketed in the UK by Deks Distribution UK, Unit 14, Gordano 19 Industrial Estate, Garonor Way, Portbury, Bristol BS20 7XE. Tel 01275 373300, Fax 01275 373399, e-mail sales@deks.org.uk

## Technical Specification

### 1 Description

1.1 Perform Flexible Roof Flashing is manufactured by coating both sides of an aluminium mesh reinforcement with a mixture of rubber polymer and additives. The lower surface is finished with a film to protect the rolls during storage.

1.2 The rolls are available with the nominal characteristics of:

roll length	4 m
roll widths (mm)	150, 250, 300, 450 and 1250
roll weight (kg)	2.1, 3.6, 4.3, 6.5 and 18
colour	black, terracotta, grey and brown.

1.3 Perform Adhesive is available for use in joints and for sealing onto tiles, slates, masonry and brickwork.

1.4 Quality control checks are carried out on incoming materials, during production and on final product, including:

- dimensions
- tearing strength
- weight.

### 2 Delivery and site handling

2.1 The product is distributed in boxed rolls marked with the size, and the BBA identification mark including the number of this Certificate.

2.2 The product should be stored upright on a smooth, clean, dry surface, under cover and protected from sunlight.

## Assessment and Technical Investigations

The following is a summary of the assessment and technical investigations carried out on Perform Flexible Roof Flashing.

## Design Considerations

### 3 General

3.1 Perform Flexible Roof Flashing when designed and installed in accordance with the relevant parts of BS 5534 : 2003, BS 6229 : 2003 and BS 8000-6 : 1990 is suitable for use in flashing applications, such as abutments, chimneys, saddles, valleys and dormers to provide a weatherproof junction.

3.2 Flat roofs are defined for the purposes of this Certificate as those roofs having a minimum finished fall of 1:80. Pitched roofs are defined as those having falls in excess of 1:6.

3.3 Limited access roofs are defined as those roofs subjected only to pedestrian traffic for maintenance of the roof covering and cleaning of gutters.

3.4 Where the product is likely to come into contact with aggressive chemicals (such as acid, alkali, oil and solvent), a test on the product should be conducted before proceeding. If any doubt arises, the Certificate holder's advice should be sought.

### 4 Practicability of installation

The material can be installed by roofing contractors experienced with this type of product.

### 5 Weathertightness



Tests confirm that Perform Flexible Roof Flashing, when incorporated into a roofing system designed and installed in accordance with conventional good practice will adequately resist the passage of moisture to the interior of the building and so contribute to the roof meeting the requirements of the national Building Regulations:

**England and Wales** — Approved Document C, Requirement C2(b), Section 6

**Scotland** — Mandatory Standard 3.10, clauses 3.10.1 and 3.10.8

**Northern Ireland** — Regulation C4(b).

## 6 Properties in relation to fire



6.1 Samples of Perform Flexible Roof Flashing, when tested in accordance with BS 476-3 : 2004 achieved a C rating for surface spread of flame.

6.2 When tested in accordance with DIN 4102-1 : 1998, the product achieved a B2 rating.

## 7 Strength

The product will resist normal impacts associated with installation and use.

## 8 Maintenance



Damaged areas can be repaired by following the Certificate holder's instructions prior to completing the roof covering.

## 9 Durability



Available test data indicate that the product should have a life in excess of 20 years.

## Installation

### 10 General

10.1 Installation of Perform Flexible Roof Flashing should be strictly in accordance with the Certificate holder's instructions and the relevant recommendations of BS 5534 : 2003, BS 6229 : 2003 and BS 8000-6 : 1990.

10.2 The product is worked the same way as lead flashing. It can be cut with a sharp knife scissors or snips. In respect of health, protective gloves should be worn during installation.

10.3 Cutting and folding can be carried out to a minimum temperature of  $-40^{\circ}\text{C}$  and when working with a lead dresser to a minimum temperature of  $-40^{\circ}\text{C}$ .

10.4 Foot traffic should be avoided or a protection board should be used when installing the product as a valley lining.

10.5 Overlap joints of 30 mm minimum are required and must be sealed with Perform Adhesive.

## Technical Investigations

### 11 Tests

11.1 Samples of Perform Flexible Roof Flashing were obtained from the Certificate holder for testing. The results of the tests carried out by, or on behalf of the BBA are summarised in Tables 1 and 2.

Table 1 Physical properties — directional

Test (units)	Mean result		Method <sup>(1)</sup>
	Longitudinal	Transverse	
Tensile strength (N per 50mm)			BS EN 12311-1
unaged	377	1445	
aged <sup>(2)</sup>	339	1481	
aged <sup>(3)</sup>	362	1403	
Elongation at break (%)			BS EN 12311-1
unaged	111	21	
aged <sup>(2)</sup>	106	18	
aged <sup>(3)</sup>	111	16	
Tear resistance (nail) (N)			BS EN 12310-1
unaged	327	259	
Low temperature foldability ( $^{\circ}\text{C}$ )			BS EN 495-5
unaged	$-40$	$-40$	
aged <sup>(3)</sup>	$-40$	$-40$	

(1) The test documents are detailed in the *Bibliography*. Numbers in the table refer to sections/parts of the various documents.

(2) UVB aged 2000 total hours UVB: 4 h UVB 313 at  $50 \pm 2^{\circ}\text{C}$ , followed by 4 h condensation at  $50 \pm 2^{\circ}\text{C}$ .

(3) 12 weeks at  $80^{\circ}\text{C}$ .

Table 2 Physical properties – general

Test (units)	Mean result	Method <sup>(1)</sup>
Dimensional stability (%)	0.0	BS EN 1107-1
Water absorption (%)	19.6	MOAT 66
Water vapour transmission ( $\text{gm}^{-2} \text{24 h}^{-1}$ )	13	BS 3177
Water vapour resistance ( $\text{MNsg}^{-1}$ )	15.9	
Peel strength (N per 50 mm) concrete substrate		MOAT 64
unaged	194	
heat aged <sup>(2)</sup>	89	

(1) The test documents are detailed in the *Bibliography*. Numbers in the table refer to sections/parts of the various documents.

(2) 28 days at 80°C.

11.2 Tests were also carried out to examine the following properties:

- dimensional checks
- ash content
- weight per unit area
- water absorption
- effect of accelerated ageing and colour stability.

## 12 Investigations

12.1 An assessment was made of results of a fire test in accordance with BS 476-3 : 2004 carried out by an independent test authority.

12.2 An examination of independent test data was made on the following:

- heat/rain cycling
- effect of accelerated ageing
- watertightness of joints.

12.3 The manufacturing process was examined, including the methods adopted for quality control, and details were obtained of the quality and composition of the materials.

## Bibliography

- BS 476-3 : 2004 *Fire tests on building materials and structures — Classification and method of test for external fire exposure to roofs*
- BS 3177 : 1959 *Method for determining the permeability to water vapour of flexible sheet materials used for packaging*
- BS 5534 : 2003 *Code of practice for slating and tiling (including shingles)*
- BS 6229 : 2003 *Flat roofs with continuously supported coverings — Code of practice*
- BS 8000-6 : 1990 *Workmanship on building sites — Code of practice for slating and tiling of roofs and claddings*
- BS EN 495-5 : 2001 *Flexible sheets for waterproofing — Determination of foldability at low temperature — Plastic and rubbers sheets for roof waterproofing*
- BS EN 1107-1 : 2000 *Flexible sheets for waterproofing — Determination of dimension stability — Bitumen sheets for roof waterproofing*
- BS EN 12311-1 : 2000 *Flexible sheets for waterproofing — Determination of tensile properties — Bitumen sheets for roof waterproofing*
- BS EN 12310-1 : 2000 *Flexible sheets for waterproofing — Determination of resistance to tearing (nail shank)— Part 1 — Bitumen sheets for roof waterproofing*
- BS EN 13501-1 : 2007 *Fire classification of construction products and building elements. Classification using test data from reaction to fire tests*
- DIN 4102-1 : 1998 *Fire behaviour of building materials and building components; Building materials; concepts, requirements and tests*
- MOAT No 64 : 2001 *UEAtc Technical Guide for the assessment of Roof Waterproofing Systems made of Reinforced APP or SBS Polymer Modified Bitumen Sheets*
- MOAT No 66 : 2001 *UEAtc Technical Guide for the assessment of non-reinforced, reinforced and/or Backed Roof Waterproofing Systems made of EPDM*

## 13 Conditions

13.1 This Certificate:

- relates only to the product/system that is named and described on the front page
- is granted only to the company, firm or person named on the front page — no other company, firm or person may hold or claim any entitlement to this Certificate
- is valid only within the UK
- has to be read, considered and used as a whole document — it may be misleading and will be incomplete to be selective
- is copyright of the BBA
- is subject to English law.

13.2 Publications and documents referred to in this Certificate are those that the BBA deems to be relevant at the date of issue or re-issue of this Certificate and include any: Act of Parliament; Statutory Instrument; Directive; Regulation; British, European or International Standard; Code of Practice; manufacturers' instructions; or any other publication or document similar or related to the aforementioned.

13.3 This Certificate will remain valid for an unlimited period provided that the product/system and the manufacture and/or fabrication including all related and relevant processes thereof:

- are maintained at or above the levels which have been assessed and found to be satisfactory by the BBA
- continue to be checked as and when deemed appropriate by the BBA under arrangements that it will determine
- are reviewed by the BBA as and when it considers appropriate.

13.4 In granting this Certificate, the BBA is not responsible for:

- the presence or absence of any patent, intellectual property or similar rights subsisting in the product/system or any other product/system
- the right of the Certificate holder to manufacture, supply, install, maintain or market the product/system
- individual installations of the product/system, including the nature, design, methods and workmanship of or related to the installation
- the actual works in which the product/system is installed, used and maintained, including the nature, design, methods and workmanship of such works.

13.5 Any information relating to the manufacture, supply, installation, use and maintenance of this product/system which is contained or referred to in this Certificate is the minimum required to be met when the product/system is manufactured, supplied, installed, used and maintained. It does not purport in any way to restate the requirements of the Health & Safety at Work etc Act 1974, or of any other statutory, common law or other duty which may exist at the date of this Certificate; nor is conformity with such information to be taken as satisfying the requirements of the 1974 Act or of any statutory, common law or other duty of care. In granting this Certificate, the BBA does not accept responsibility to any person or body for any loss or damage, including personal injury, arising as a direct or indirect result of the manufacture, supply, installation, use and maintenance of this product/system.

